

Instruction Manual

Screwed End Swing Check Valve

SS200CK

HIM-080ersion: **B**

Office : 4061 CLOUGH WOODS DR. BATAVIA, OHIO 45103

Fax: 513 752 8267 Tel: 513 752 5600

	Screwed End Swing Check Valve SS200CK	Version	B
		Date	Nov.13,2012
Document No.	HIM-080		

CONTENTS

1. Introduction and Safety Information	1
1.1 Introduction	1
1.2 Safety Information.....	1
2. Storage and Preparation	2
2.1 Storage	2
2.2 Preparation	2
3. Installation and Operation	3
3.1 Installation	3
3.2 Operation.....	3
4. Maintenance and Repair	4
4.1 Inspection and Maintenance	4
4.2 Trouble-Shooting.....	5
4.3 Disassembly.....	5
4.4 Reassembly	5
5. Quality Assurance and Service	6
5.1 Quality Assurance.....	6
5.2 Service.....	6
6. Technical Parameters.....	6
6.1 Torque.....	7
6.2 Pressure-Temperature Ratings	7
6.3 Swing Check Valve Structure	8
7. Swing Check Valve structure	10

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	1

1. INTRODUCTION AND SAFETY INFORMATION

1.1 INTRODUCTION

This manual has been prepared to serve as a guide to insure continuous satisfactory service and assist in restoring a valve to proper working condition.

It covers 200 WOG screwed end swing stainless steel check valves. The installation, storage, operation, disassembly / reassembly inspection and repair, service problems, maintenance and preventive maintenance covering these check valves are also included in this manual.

Prior to performing any work on these check valves, it would be useful to have a general understanding of their construction.

1.2 SAFETY INFORMATION

The following general safety notices supplement the specific warnings and cautions appearing elsewhere in this manual. They are recommended precautions that must be understood and applied during operation and maintenance of the equipment covered herein.

- a. Do not attempt to disassemble a check valve while there is pressure in the line. Make sure both upstream and downstream pressures are removed. Disassemble with caution in the event all pressures have not been relieved.
- b. To prevent check valve distortion, inefficient operation, or early maintenance problems, support piping on each side of the check valve.

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	2

2. STORAGE AND PREPARATION

2.1 STORAGE

2.1.1 Temporary Storage

If the check valve is to be stored before installation, the following should be observed.

- a. Keep the check valve wrapped and protected as shipped from the manufacturer.
- b. Do not remove the plastic bag or protective end covering until the check valve is ready for installation. This will reduce the possibility of foreign material damaging internal check valve components.
- c. Check valve stored outdoors should be positioned such that water dose not accumulate in the valve body.

2.1.2 Long Term Storage

If the check valves are to be stored more than of one year, they should be prepared in the following manner.

- a. Store the check valve in a dry area or protect the cavity by applying a preservative coating.
- b. Do not remove the protective end covering. (If any)
- c. Check valve which will remain in storage for an excessive period of time should have a preservative applied to the external surface.
- d. Do not store the valves outdoors.

2.2 PREPARATION

- a. Remove the end protection. (If any)
- b. Prior to shipment from the manufacturer, a preservative may have been applied to the inner body of the check valve.
This preservative maybe removed with a solvent.
- c. The inside of the check valve should be inspected and blown out with compressed air. As far as possible adjacent piping must be clean and free from debris to prevent early foulness of the check valve.
- d. To prevent check valve distortion, inefficient operation or early maintenance problems, support piping on each side of the check valve.
- e. Install the check valve according to the flow indicator on the body.

		<p style="text-align: center;">Screwed End Swing Check Valve SS200CK</p>		Version	B
				Date	Nov.13,2012
Document No.	HIM-080			Page	3

3. INSTALLATION AND OPERATION

3.1 INSTALLATION

Do not dismantle these check valves before fitting, treat as a unit. Taper thread fittings should not be over-tightened. In some applications screwed check valves are back welded on site and these check valves must be dismantled as per instruction for weld end valves.

3.2 OPERATION

The check valves' operation is automatic and requires no assistance.

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	4

4. MAINTENANCE AND REPAIR

4.1 INSPECTION AND MAINTENANCE

A periodic inspection and maintenance schedule should be established for each check valve. The time frames given for the implementation of these schedules are to be used as a guide only in establishing routine inspection and maintenance schedules. Exact time periods for performing these procedures cannot be provided due to the unknown nature of the service conditions each valve is in.

4.1.1 Periodic Inspection

A periodic inspection should be performed on each unit. The time frame should be adjusted depending on usage and service conditions. An infrequently used unit may have more time between inspections than a check valve in constant service.

A periodic inspection should include the following:

- a. Examine the check valve for cleanliness.
- b. If check valve is in service and under pressure:
 - (1) Examine the body to flange or end cap connection for leakage through the gasket. If leakage is found, tighten the cap until the leakage stops. If the leakage persists, see section 4.2 "Troubleshooting".
 - (2) Inspect the exterior of the check valve for cleanliness. Remove any dirt, grime or oil from the body and flange or end cap.
- c. After the system is depressurized:

Inspect the check valve internally. Remove any dirt, grime or oil from the check valve.

4.1.2 Post Inspection

After completion of a periodic inspection, check valves that are providing satisfactory service require no further disassembly or inspection. Should a check valve be found which is not performing satisfactorily, see section 4.2 "Trouble-Shooting".

4.1.3 Maintenance

Other than periodic inspection, no routine maintenance is required. Routine replacement of parts, such as gasket is not usually performed until required. Once in service, it may become apparent that these and other parts require repair or replacement due to usage and service conditions. A maintenance schedule should be developed taking these conditions into consideration. Parts can be replaced during a routine overhaul.

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	5

4.2 TROUBLE-SHOOTING

The following chart will cover the various problems which are common to most check valves.

The information provided will aid in isolating and correcting these problems.

PROBLEM	PROBABLE CAUSE	SOLUTION
Leakage	a. Cap are loose b. Gasket is damaged c. Body or cap faces are damaged	a. Tighten the cap b. Disassemble and install a new gasket c. Repair and install a new gasket
Disc Damaged	c. Internal components are damaged or worn	c. Inspect internal components and repair as required

Table 1 - Trouble-Shooting

4.3 DISASSEMBLY

WARNING

To prevent injury ensure that all pressure is removed from the valve both upstream and downstream before disassembly.

- a. Caution should be taken when loosening the cap as pressure may still be present.
- b. Once assured there is no more pressure in the line, remove the check valve, taking care not to scratch it.
- c. Remove the cap and remove the gasket from the valve body flange.
- d. Loosening the plug and remove the disc from the check valve.

4.4 REASSEMBLY

- a. Thoroughly clean the check valve interior and all components. Remove all oil, grease or other foreign material. Clean the body and all bolting.
- b. Install the disc and plug carefully.
- c. Reassembly the gasket and cap.

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	6

5. QUALITY ASSURANCE AND SERVICE

5.1 QUALITY ASSURANCE

OVC's warrants its products to be free from defects in material and workmanship for a period of eighteen (18) months from the date of shipment or twelve (12) months from the date of installation whichever comes first. This warranty is limited to the repair or replacement of the defective item providing that it was handled, installed, used and maintained in accordance with the manufacturer's recommendations and applicable standard industry practices. OVC will not be liable for any additional direct or indirect costs beyond the repair or replacement of the defective item.

This warranty is in lieu of any other warranty expressed or implied.

5.2 SERVICE

Manufacturer may provide field installation and debugging where contractually specified.

Manufacturer will follow up the quality of the valve provided and offer service in accordance with customer requirements.

		Screwed End Swing Check Valve SS200CK	Version	B
			Date	Nov.13,2012
Document No.	HIM-080		Page	7

6. TECHNICAL PARAMETERS

6.1 SPECIFICATION LIST

Type	SS200CK
Technical Parameters	
Nominal pipe size	DN15 ~ DN80 (1/2"~3")
Nominal pressure	200 WOG
Working temperature	-20°C ~ 200°C, (-4°F ~ 392°F)
Medium	Water, Steam, Oxygen, Vacuum, Chemical, Oil, Food Processing
Pressure test	API 598

Table 2 - Specification List

6.2 TORQUE

NPS	DN	Cap Nut Torque	
		N-m	in-lb
1/2"	15	15	133
3/4"	20	15	133
1"	25	20	177
1-1/4"	32	25	221
1-1/2"	40	30	266
2"	50	40	354
2-1/2"	65	50	443
3"	80	65	575

Table 3 – Cap Nut Torque

		<p style="text-align: center;">Screwed End Swing Check Valve SS200CK</p>		Version	B
				Date	Nov.13,2012
Document No.	HIM-080			Page	8

6.3 PRESSURE-TEMPERATURE RATINGS



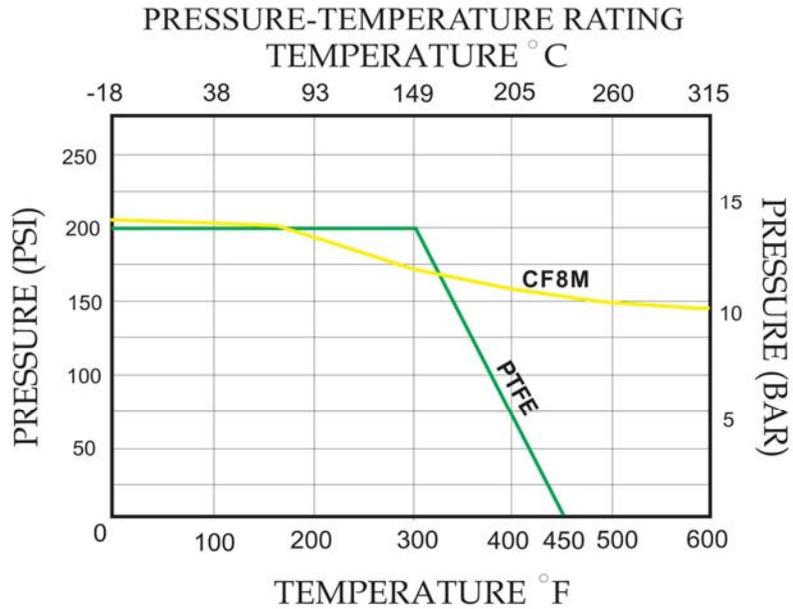


Table 4 - Pressure-Temperature Ratings

7. SWING CHECK VALVE STRUCTURE

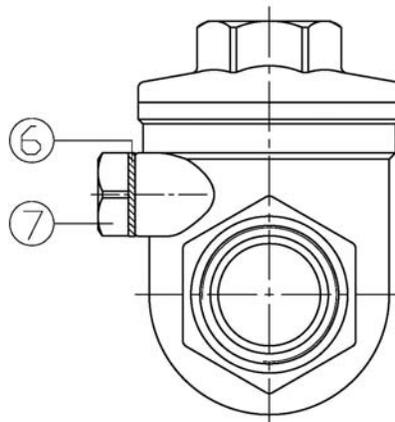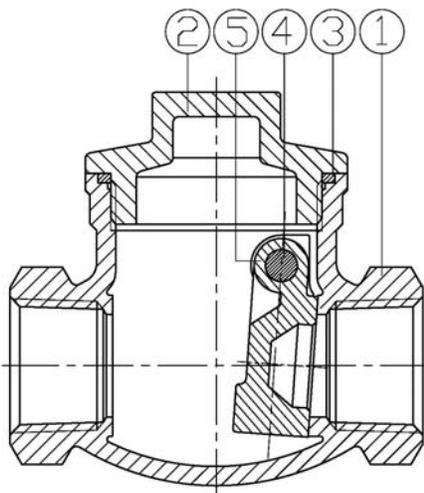

ITEM	PARTS
1	BODY
2	CAP
3	GASKET
4	PLUG
5	DISC
6	GASKET
7	BOLT